

### PANEL SCHEDULE

120/208V, 3Ø, 4W, SII (100 A MLO) TYPE HQO SURFACE MOUNT TEL

CKT NO.	POLE	TRIP	VOLT AMP	REMARKS	CKT NO.	POLE	TRIP	VOLT AMP	REMARKS
1	1	20	600	LTG. RM. 1, 2, 3 & CARR 4, 5	2	1	20	300	LTG. MECH. STOR. & WORK RM.
3	1	20	700	LTG. GIBLS. FOYS	4	1	20	500	LTG. WALKWAY
5	1	20	900	LTG. CL. ROOM 17	6	1	20	900	LTG. CL. ROOM 14
7	1	20	900	" " 16	8	1	20	900	" " 13
9	1	20	900	" " 15	10	1	20	1200	" " 12
11	1	20	1200	RECEPT	12	1	20	250	RECEPT
13	1	20	700	RECEPT	14	1	20	900	RECEPT
15	1	20	900	RECEPT	16	1	20	600	MOTOR VALVES
17	1	20	900	FUTURE LIGHTING	18	1	20	900	FUTURE LIGHTING
19	1	20	900	" " "	20	1	20	900	" " "
21	1	20	900	" " RECEPT	23	1	20	900	" " RECEPT
23	1	20	600	SPARE	24	1	20	600	SPARE



TOTAL CIRCUIT LOAD 20.0KVA  
ESTIMATED LEANIL 16.0KVA

### FIXTURE SCHEDULE

TYPE	MANUFACTURER	CAT NO.	LAmps	MOUNTING	REMARKS
A	LITHONIA	WAB 24 AH	2 F40 T12 CW	SURFACE	
B					
C	BEYANT	5-28	1-100W	SURFACE	
D	MCPHILBEII	43-37	2-50W	SURFACE	WITH FINISHING COLLAR # P4174
E	MCPHILBEII	43-95	1-100W	SURFACE	

#### NOTES:

- 1 APPLETON TYPE FS BOX WITH BLANK CAST PLATE & GASKET. MOUNT BOX ABOVE CEILING.
- 2 SWITCH BOX FLUSH WITH WALL WITH BLANK CAST PLATE & SOCKET 15" ABOVE FINISHED FLOOR.
- 3 11Ø JUNCTION BOX WITH COVER ABOVE CEILING. MAKE PROVISION FOR 1Ø & E FOR FUTURE INSTALLATION.
- 4 1Ø WIRE JUNCTION BOX WITH COVER ABOVE CEILING. MAKE PROVISION FOR FUTURE INSTALLATION.

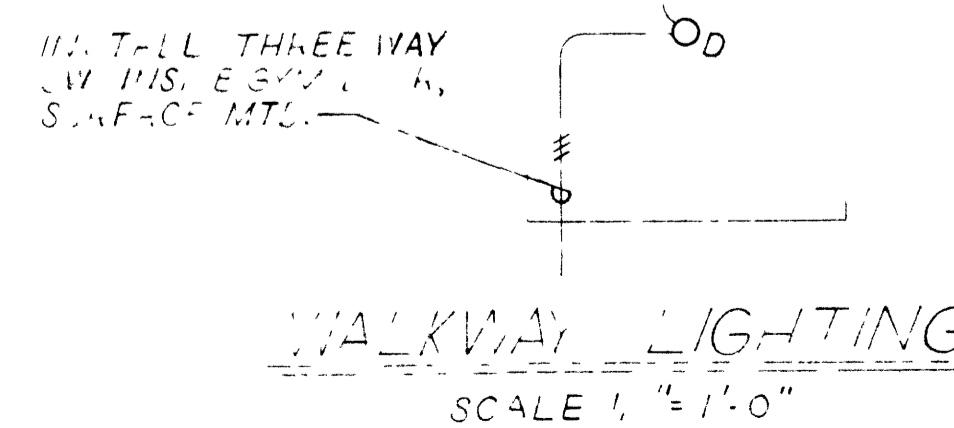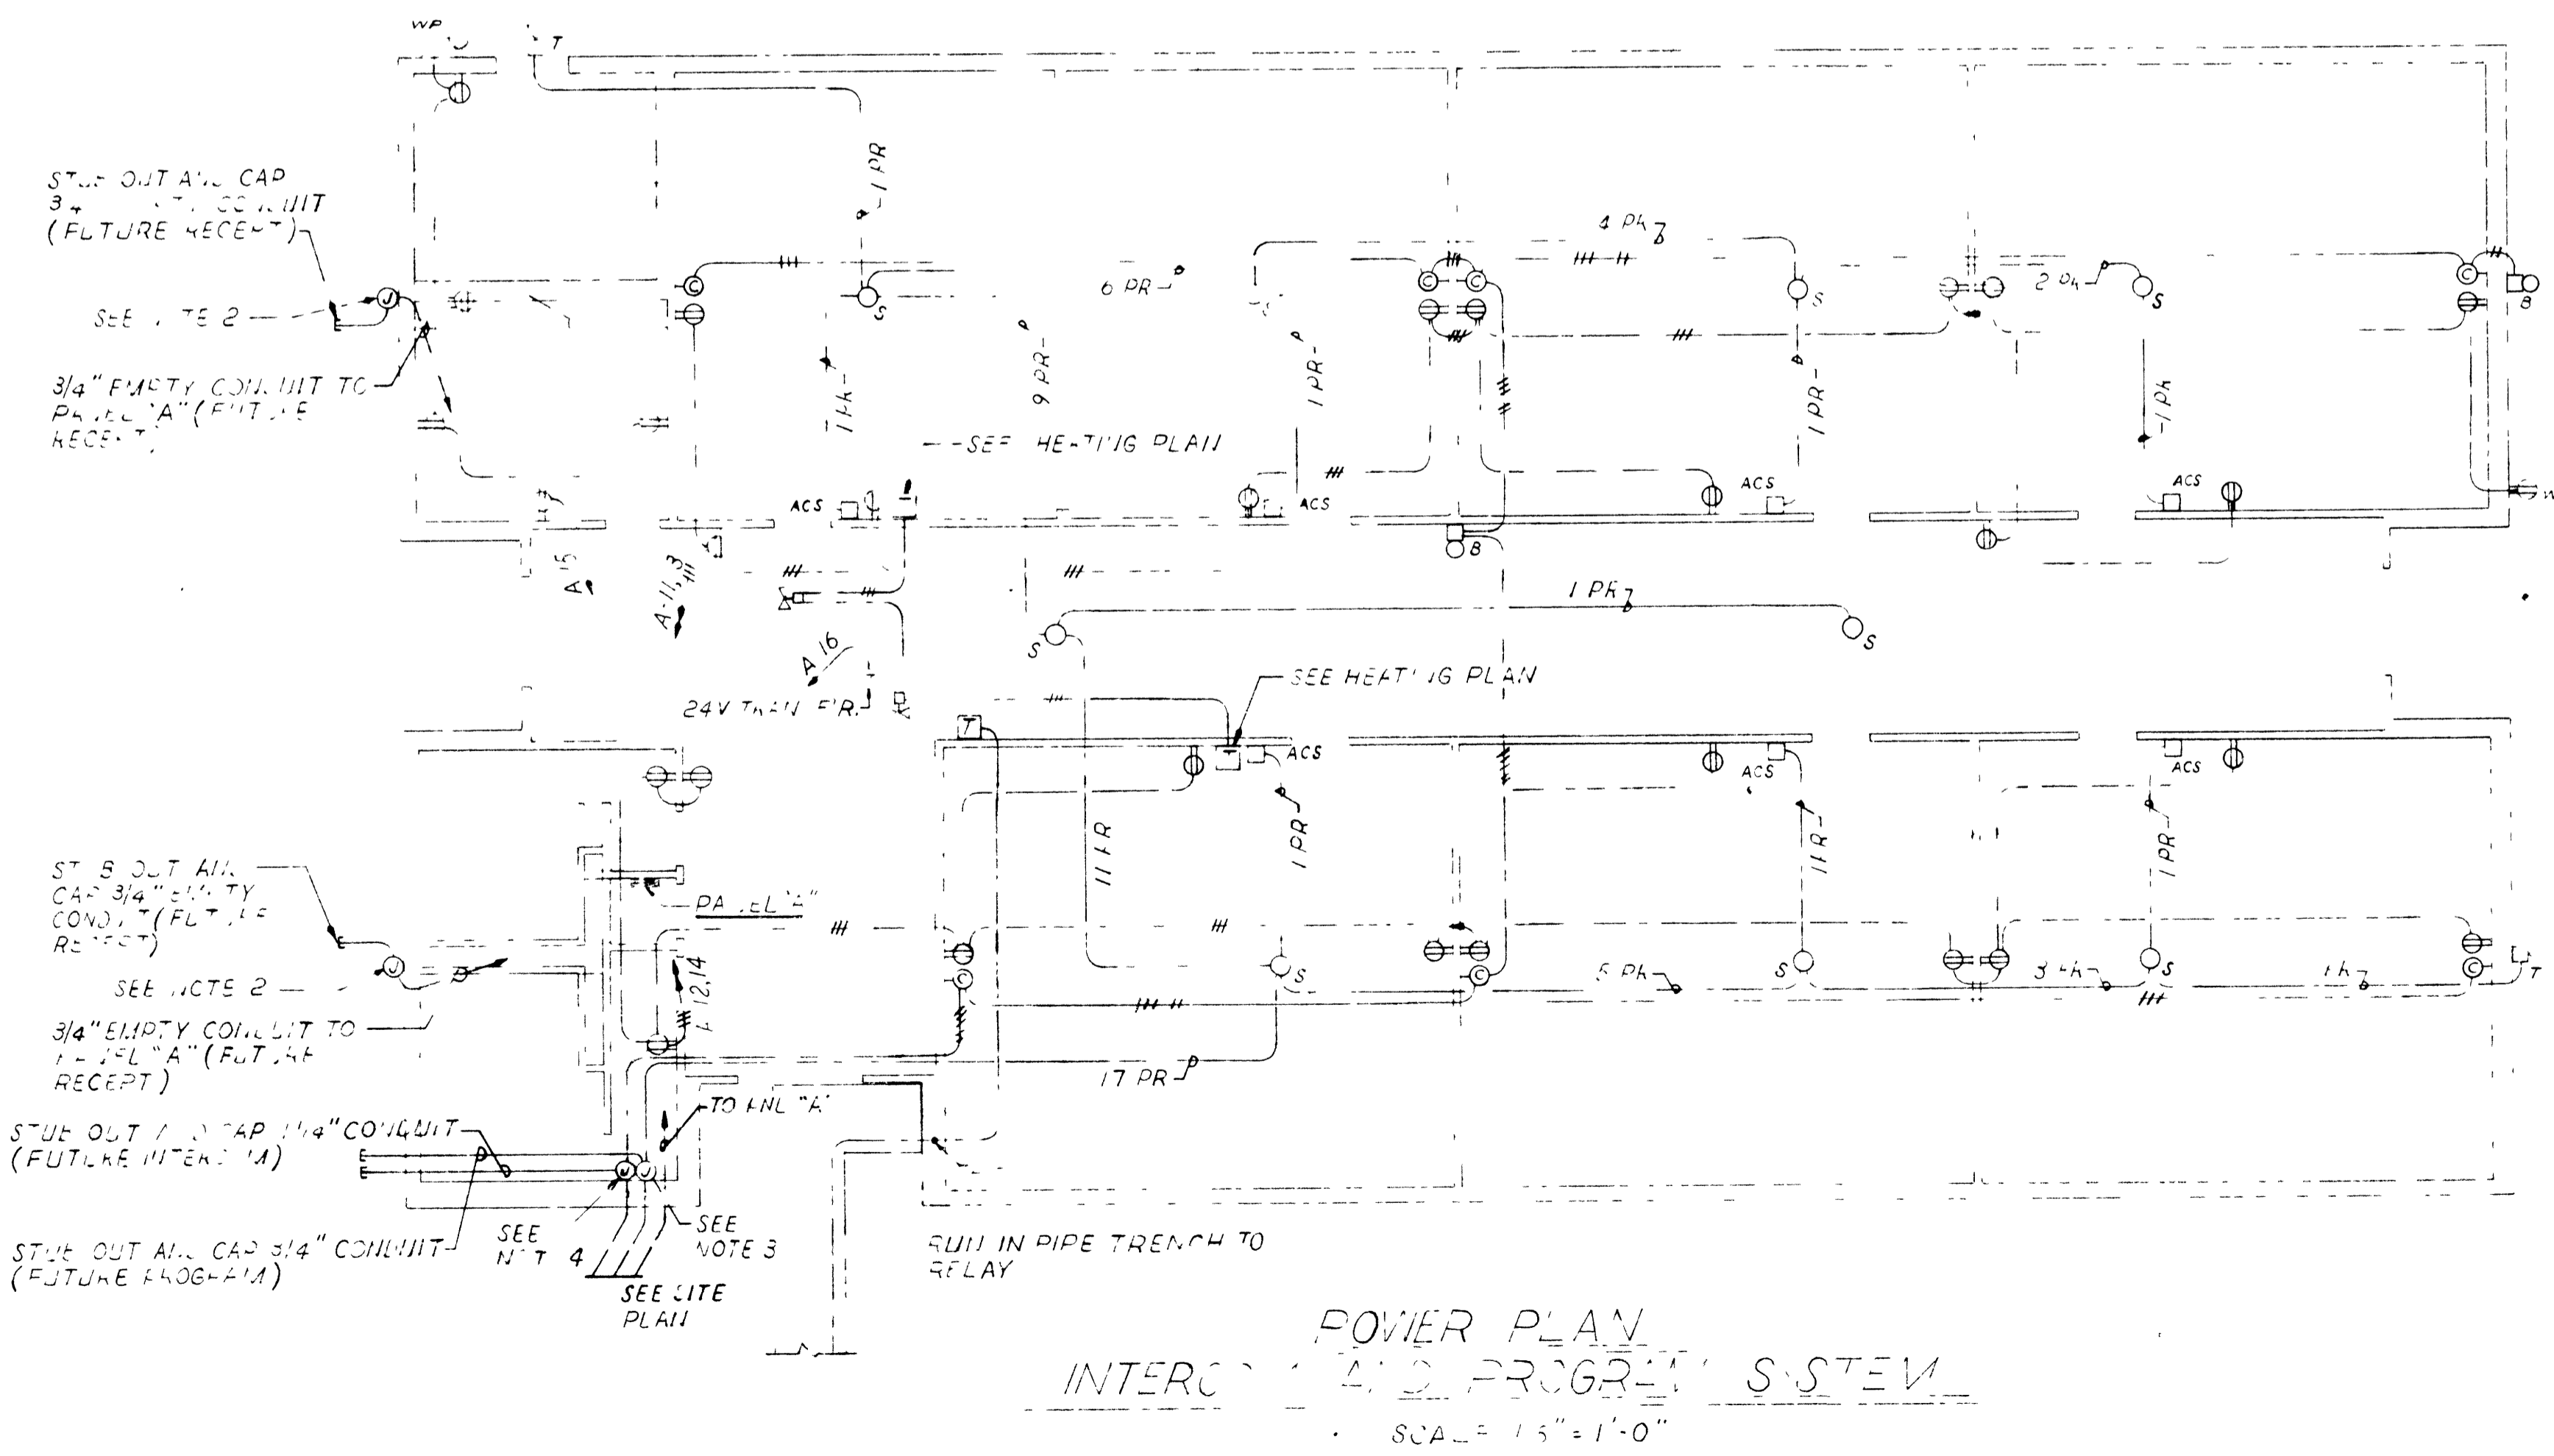

RECEIVED

JUN 25 1968

200 1420 DIVISION OF SCHOOL PLANNING

A CLASSROOM ADDITION TO		
<b>ANDREWS HIGH SCHOOL</b>		
ANDREWS, NORTH CAROLINA		
DRAWN BY	FLOOR PLAN	DATE 6-11-68
JAMES L. PADGETT, AIA, ARCHITECT		<b>E-2</b>
SUITE 405 NORTHWESTERN BANK BUILDING ASHEVILLE, NORTH CAROLINA 28807		
		SHEET NO. OF 2